


2" FIRE LINE SERVICE
(METER REQUIRED)

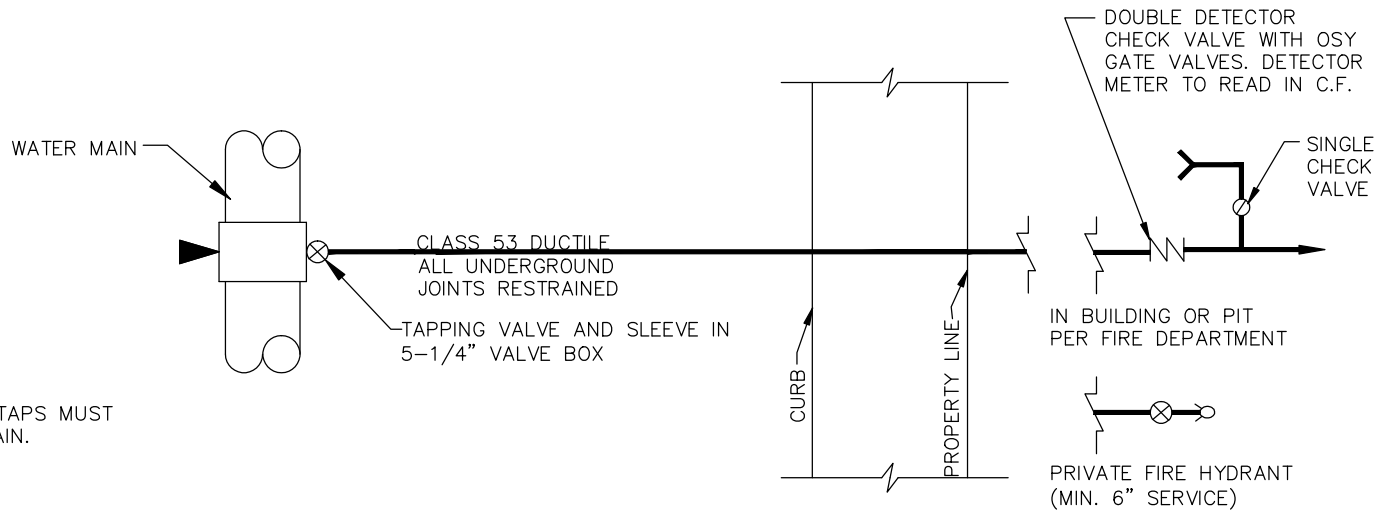

NOTE:
DOMESTIC AND FIRE PROTECTION TAPS MUST
BE SEPARATE TAPS AT WATER MAIN.

4" AND LARGER FIRE LINE SERVICE
(METER REQUIRED)

WALL/POST INDICATOR
VALVES SHALL BE ADDED
ON PREMISES AT FIRE
DEPARTMENT REQUEST