



HOSE BIBB

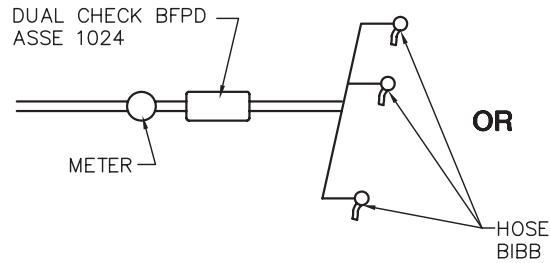


NON-RECERTIFIABLE BFPDS
(ASSE 1001, ASSE 1011) ON
HOSE BIBBS

YARD HYDRANT

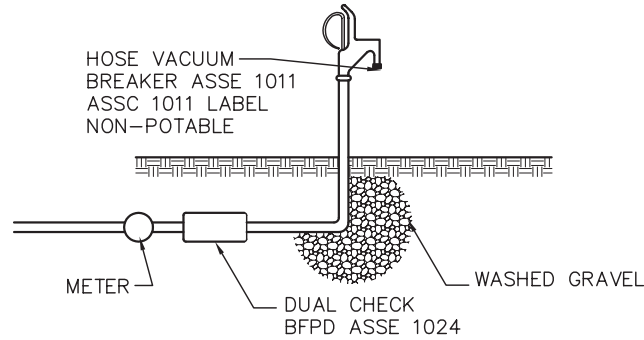

SPRINKLER SYSTEM

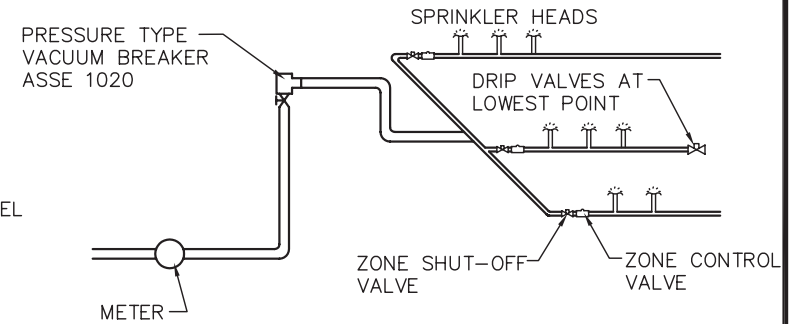

CONDITIONS

- A. SHUT-OFF VALVES ARE ALLOWED DOWNSTREAM OF THE BFPD.
- B. THE PRESSURE TYPE VACUUM BREAKER MUST BE A MINIMUM OF 12" ABOVE THE HIGHEST SPRINKLER HEAD.

NOTES

- A. A DRAWING OF EACH PROPOSED IRRIGATION SYSTEM MUST BE APPROVED BY THE CITY PRIOR TO CONSTRUCTION.
- B. IF IRRIGATION SYSTEM IS NONE OF THE ABOVE, USE A REDUCED PRESSURE BACKFLOW PREVENTER, (ASSE 1013), AFTER THE WATER METER.

YARD MAIN SYSTEM ARRANGEMENT

