



ACCESSIBLE PARKING SPACES FOR CARS

SIGN WITH INTERNATIONAL SYMBOL OF ACCESSIBILITY MOUNTED 6' ABOVE THE PAVEMENT ON BOTH SIDES OF 5' AISLE.

TYPICAL ACCESSIBLE PARKING SPACE 9' X 19' MINIMUM

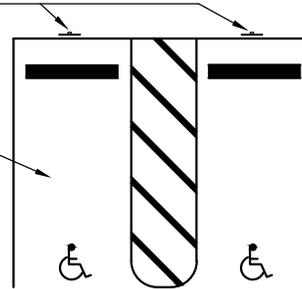

CURB-SIDE ACCESSIBLE PARKING SPACES

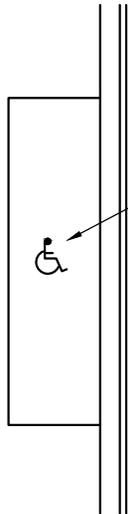

SIGN WITH INTERNATIONAL SYMBOL OF ACCESSIBILITY MOUNTED 6' ABOVE THE PAVEMENT.

TYPICAL CURB-SIDE PARKING SPACE 8' X 23' MINIMUM


TYPICAL ACCESSIBLE PARKING AISLE 5' X 19' MINIMUM

VAN-ACCESSIBLE PARKING SPACES

SIGN WITH "VAN ACCESSIBLE" AND THE INTERNATIONAL SYMBOL OF ACCESSIBILITY MOUNTED 6' ABOVE THE PAVEMENT ON LEFT SIDE OF 8' AISLE.

SIGN WITH INTERNATIONAL SYMBOL OF ACCESSIBILITY MOUNTED 6' ABOVE THE PAVEMENT ON RIGHT SIDE OF 8' AISLE.

TYPICAL VAN ACCESSIBLE PARKING SPACE 9' X 19' MINIMUM

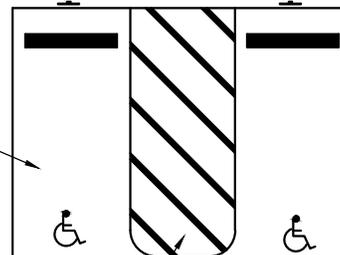

TYPICAL VAN ACCESSIBLE PARKING AISLE 8' X 19' MINIMUM

NOTES

A. AN ACCESSIBLE ROUTE MUST ALWAYS BE PROVIDED FROM THE ACCESSIBLE PARKING TO THE ACCESSIBLE ENTRANCE. ACCESSIBLE PARKING SPACES SHOULD BE LOCATED ON THE SHORTEST ACCESSIBLE ROUTE OF TRAVEL TO AN ACCESSIBLE FACILITY ENTRANCE, WHENEVER POSSIBLE. THE MAXIMUM PAVEMENT SLOPE IS TO BE 2% (1:50) IN ALL DIRECTIONS IN PARKING STALL AND AISLE AREAS. THE MAXIMUM SLOPE ALONG THE ACCESSIBLE ROUTE SHALL NOT BE GREATER THAN 1:12 IN THE DIRECTION OF TRAVEL. AN ACCESSIBLE ROUTE NEVER HAS CURBS OR STEPS, MUST BE A MINIMUM OF 3' IN WIDTH, AND MUST HAVE A FIRM, STABLE, SLIP-RESISTANT SURFACE. HANDRAILS MUST BE PROVIDED ALONG THE ACCESSIBLE ROUTE WHERE THE SLOPE IS MORE THAN 1:20 AND THE VERTICAL RISE IS GREATER THAN 6". THERE CAN BE NO DROPOFFS ALONG THE EDGES OF THE ACCESSIBLE ROUTE.

B. THE AISLE DIMENSIONS ARE TO BE 5' X 19' MINIMUM FOR ACCESSIBLE PARKING SPACES FOR CARS AND 8' X 19' FOR VAN ACCESSIBLE PARKING SPACES. ALL PARKING STALLS ARE TO BE 9' X 19' MINIMUM EXCEPT CURB-SIDE SPACES WHICH SHALL BE 8' X 23' MINIMUM.

C. A HANDICAP SYMBOL SHALL BE PAINTED AT THE END OF ALL HANDICAP PARKING SPACES IN PARKING LOTS AND IN THE CENTER OF CURB-SIDE ACCESSIBLE PARKING SPACES. THE MINIMUM SIZE SHALL BE 28".

D. IF THE TOTAL NUMBER OF PARKING SPACES IN THE PARKING AREA IS BETWEEN 1 AND 100, THERE SHALL BE 1 HANDICAP PARKING SPACE PROVIDED PLUS ONE HANDICAP PARKING SPACE PER 25 PARKING SPACES. IF THE TOTAL NUMBER OF PARKING SPACES IN THE PARKING AREA IS BETWEEN 101 AND 200, THERE SHALL BE 5 HANDICAP PARKING SPACES PROVIDED PLUS ONE HANDICAP PARKING SPACE PER EACH 50 PARKING SPACES OVER 100. IF THERE ARE OVER 200 PARKING SPACES IN THE PARKING AREA, THERE SHALL BE 6 HANDICAP PARKING SPACES PROVIDED PLUS ONE HANDICAP PARKING SPACE PER EACH 75 PARKING SPACES OVER 200. THERE SHALL BE A MINIMUM OF ONE VAN ACCESSIBLE PARKING SPACE AND ONE 8' AISLE PROVIDED IN ALL PARKING AREAS.