



NOTES

- A.** OUTSIDE METER PITS ARE DISCOURAGED, METER PIT INSTALLATION SHALL OCCUR ONLY WITH THE UTILITY DIRECTOR'S PERMISSION. THIS INSTALLATION SHALL NOT BE ALLOWED UNLESS, IN THE JUDGEMENT OF THE UTILITY DIRECTOR, THIS IS THE ONLY PRACTICAL METHOD TO SERVICE THE ACCOUNT.
- B.** CONCRETE METER PIT, OTHERS MUST BE APPROVED PRIOR TO INSTALLATION.
- C.** METER PIT AND CURB STOP TO BE LOCATED AS DIRECTED BY THE CITY.
- D.** METER PIT AND METER PROVIDED BY CITY AND PAID FOR THROUGH TAPPING FEE.
- E.** UNSATISFACTORY INSTALLATION WILL RESULT IN WATER NOT BEING TURNED ON.
- F.** METER PIT LID MUST BE FLUSH OR 1" BELOW FINISHED GRADE. IF FRAME OF METER LID IS SHOWING, POSSIBILITY OF FREEZING OF METERS AND SERVICE LINES IS INCREASED. CITY'S RESPONSIBILITY STOPS AT THE FIRST SHUT-OFF VALVE.
- G.** PITS MUST USE METER YOKES

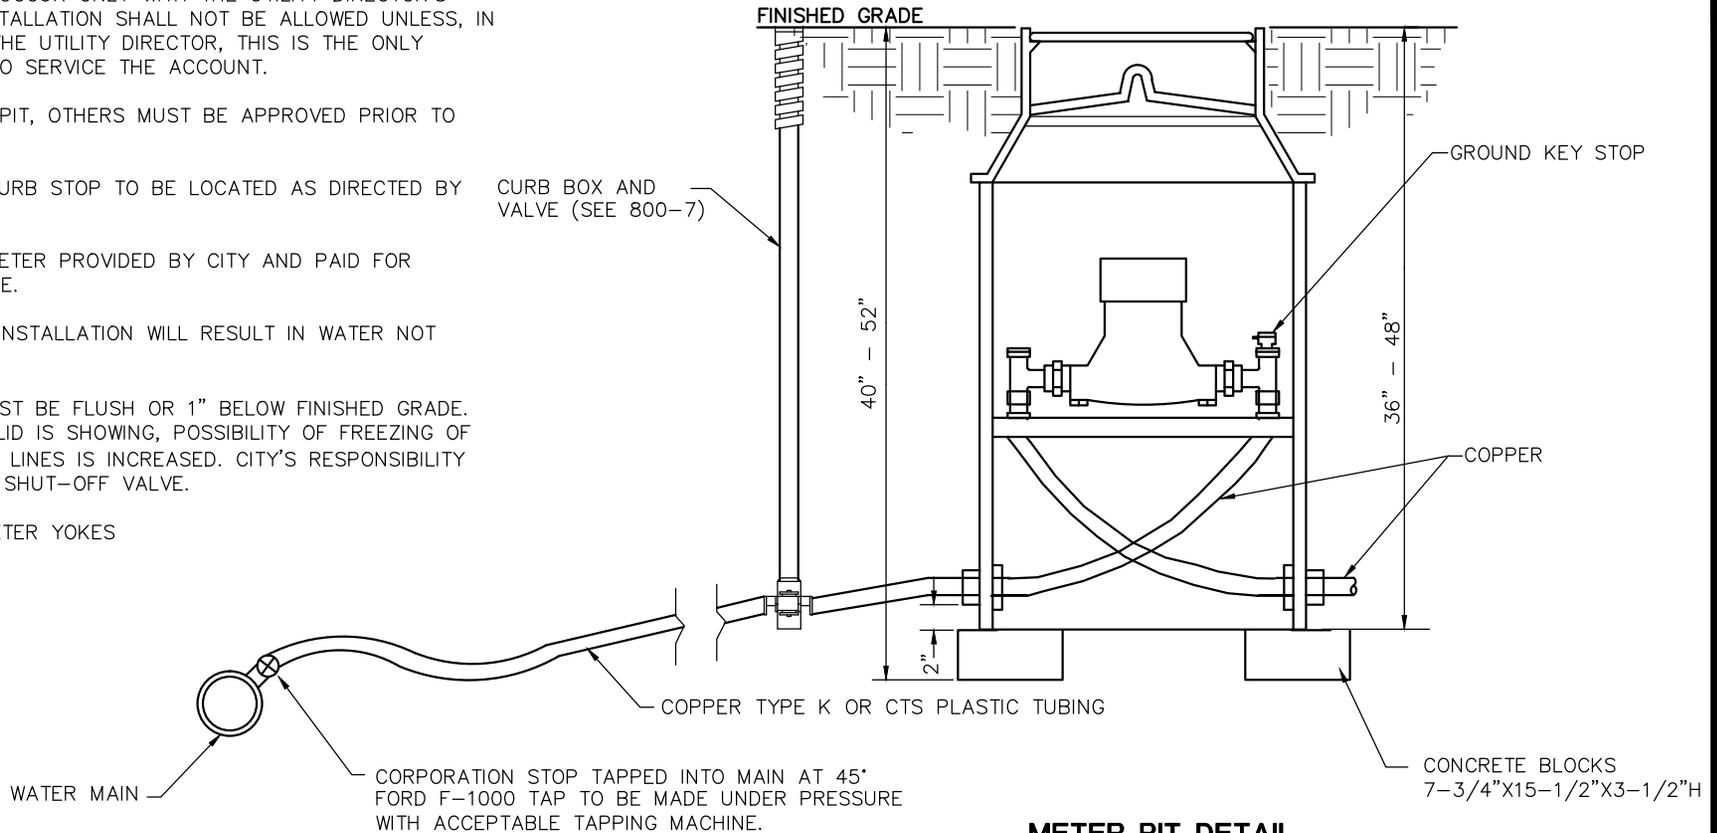

METER PIT DETAIL

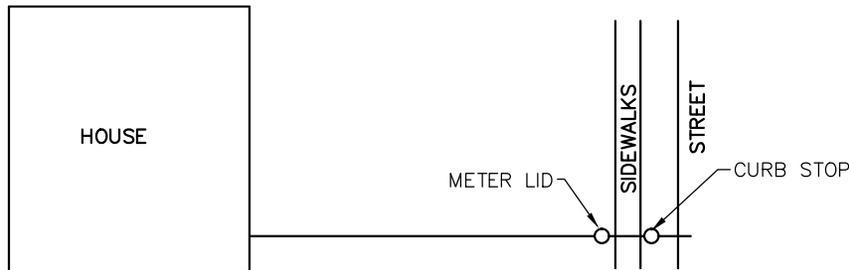

FORD CATALOG COPPERSETTER NO.	SERVICE PIPE SIZE	METER	SPREAD	TILE STYLE
V72-H	3/4"	5/8" X 3/4"	7-7/8"	20" DIA.
V72-H	3/4"	3/4"	9-3/8"	20" DIA.
V72-H	1"	1"	11-1/8"	24" DIA.