


EXISTING DOMESTIC WATER WITH NO BACKFLOW DEVICE REQUIRED

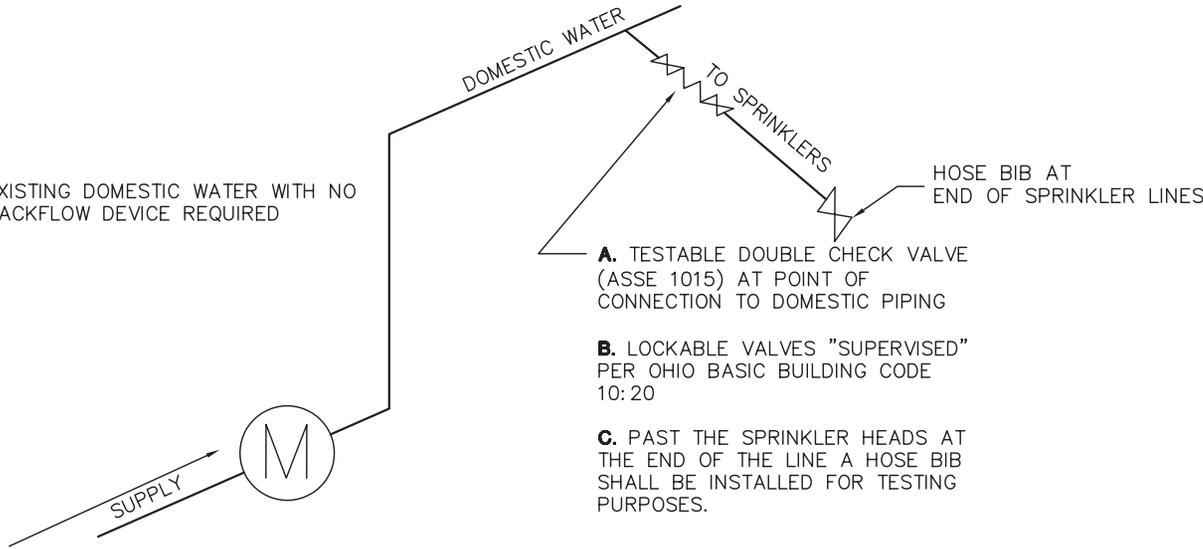


A. TESTABLE DOUBLE CHECK VALVE (ASSE 1015) AT POINT OF CONNECTION TO DOMESTIC PIPING

B. LOCKABLE VALVES "SUPERVISED" PER OHIO BASIC BUILDING CODE 10:20

C. PAST THE SPRINKLER HEADS AT THE END OF THE LINE A HOSE BIB SHALL BE INSTALLED FOR TESTING PURPOSES.

HOSE BIB AT END OF SPRINKLER LINES

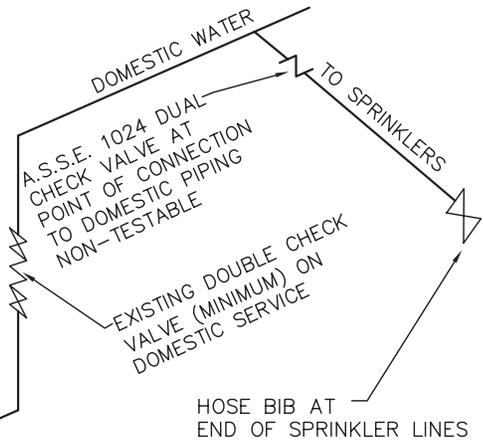

A.S.S.E. 1024 DUAL CHECK VALVE AT POINT OF CONNECTION TO DOMESTIC PIPING NON-TESTABLE


EXISTING DOUBLE CHECK VALVE (MINIMUM) ON DOMESTIC SERVICE

HOSE BIB AT END OF SPRINKLER LINES

NOTE:

A. ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEM WILL AFFECT ORIGINAL FLOW CALCULATION

EXISTING DOMESTIC BACKFLOW

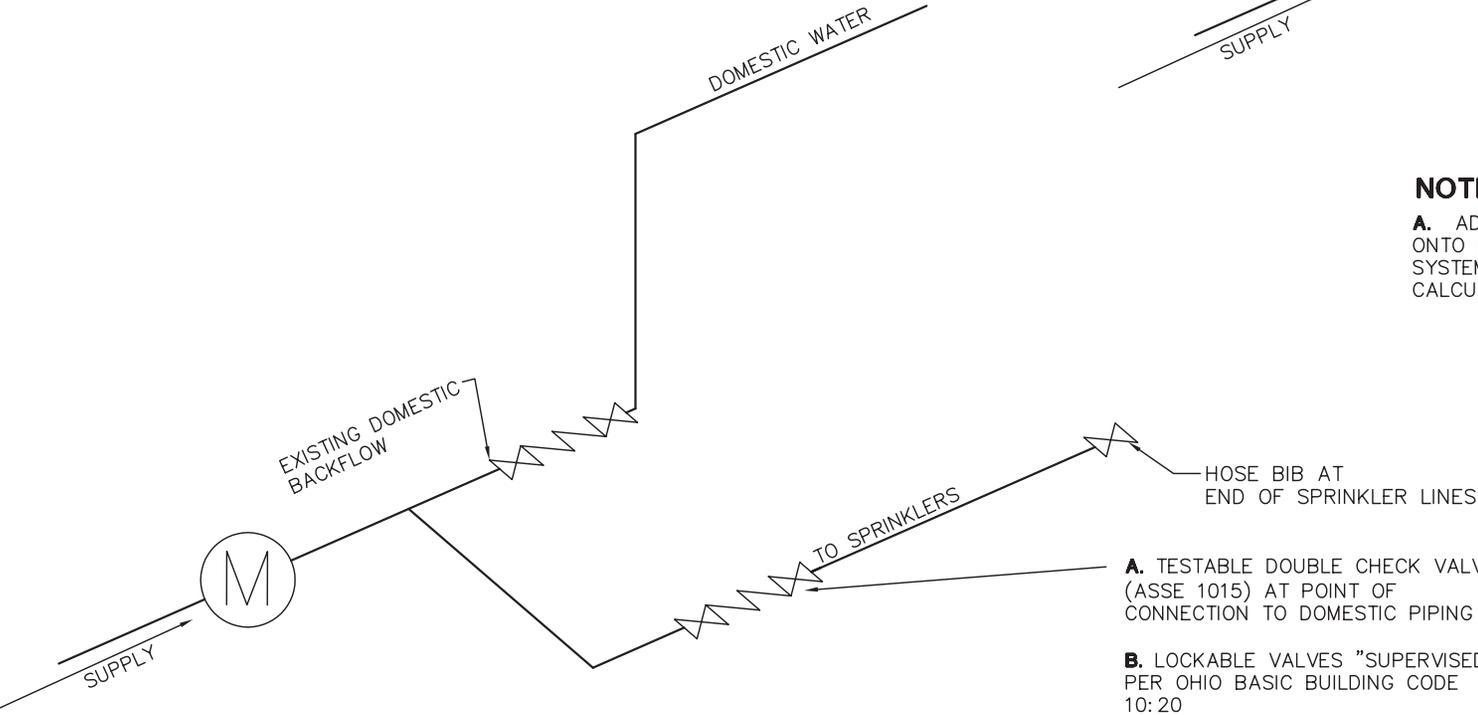

A. TESTABLE DOUBLE CHECK VALVE (ASSE 1015) AT POINT OF CONNECTION TO DOMESTIC PIPING

B. LOCKABLE VALVES "SUPERVISED" PER OHIO BASIC BUILDING CODE 10:20

HOSE BIB AT END OF SPRINKLER LINES